5 Simplex

UL, ULC, CSFM Listed; FM Approved; MEA (NYC) Acceptance*

Addressable Peripherals

4090-9121 Security Monitor IAM (Individual Addressable Module)

Features

For use with Simplex[®] 4100ES, 4100U and 4010ES Fire Alarm Control Panels providing IDNet™ communications

Addressable communications supply both data and power over a single wire pair to provide:

- Supervised Class B monitoring of normally closed or normally open dry contact security devices
- Monitored conditions are Open, Normal, Abnormal, and Short
- Abnormal occurs with ±50% of monitor loop current change
- Total wiring distance from Security IAM to supervised contacts up to 500 ft (152 m)

Compact, sealed construction:

- Enclosed design minimizes dust infiltration
- Mounts in a standard single gang electrical box
- Screw terminals for wiring connections
- Visible LED flashes to indicate communications
- Optional covers are available to allow LED to be viewed after installation (requires mounting bracket, ordered separately)


UL listed to Standard 1076

Description

Security Monitor IAM model 4090-9121 has both power and communications supplied by a two-wire 4100ES, 4100U or 4010ES IDNet circuit. It provides location specific addressability for up to five initiating devices (such as window or door magnet switch contacts or other similar security devices) by monitoring the circuit wiring connections to either normally closed or normally open dry contacts (one type per IAM).

Operation. When the circuit is "armed" by selection from the fire alarm control panel, such as during nonworking hours, monitor loop activity (short, open, or abnormal) causes a priority 2 alarm at the panel.

When the circuit is "disarmed", such as during normal working hours, normal and abnormal conditions would be tracked as events. Depending on the point type selected, an open or short in the monitored circuit wiring will cause a trouble to be reported or a short can be tracked as an event.



4090-9121 Security Monitor IAM (shown approximately full size)


Product Selection

| Model 4090-9121 | Description Security Monitor IAM | | |
|---------------------------|--|--|--|
| 4090-9806 | Semi-flush mount | Optional trim plate with LED viewing window, requires 4090-9810 mounting | |
| 4090-9807 | Surface mount box | bracket, includes mounting screws; galvanized steel | |
| 4090-9810 | Mounting bracket, mounts IAM to box, provides screw holes for trim plate, required for optional trim plates | | |
| 4081-9010 (733-973) | 1 kΩ Resistor Harness, use for series connection to N.O. switches | | |
| 4081-9015 (733-093) | 1.5 kΩ Resistor Harness, use for end-of-line resistor when connected to N.O. switches | | |
| 4081-9014 (733-092) | 2.4 kΩ Resistor Harness, use for series and end-of-line resistor when connected to N.C. switches (2 required) | | |


Specifications

| Communications | 4100ES/4100U/4010ES IDNet, one address | | |
|----------------------------|---|--------------|--|
| Power Requirements | Consumes two (2) unit loads, power is supplied from the IDNet SLC (signaling line circuit) | | |
| IDNet Channel | 32 max. on a 64 pt. channel (no other | | |
| Loading | 63 max. on a 127 pt. channel devices on | | |
| Reference | 125 max. on a 250 pt. channel | the channel) | |
| Monitored Contacts | Dry contacts, up to 5 in series for normally closed (N.C.), or up to 5 in parallel for normally open (N.O.), requires two resistor harnesses per wiring type selected (see above) | | |
| Wire Connections | Screw terminals for in/out wiring, 18 to 14 AWG wire (0.82 mm ² to 2.08 mm ²) | | |
| IAM to Contacts | 500 ft (152 m) maximum, within same building | | |
| IDNet | 2500 ft (762 m) max. distance from control panel | | |
| Communications Distance | 10,000 ft (3048 m) maximum total wiring distance (including T-Taps) | | |
| Dimensions | 1-9/16" W x 1-3/4" H x 1-1/4" D (40 mm x 44 mm x 32 mm) | | |
| Housing Material | Black thermoplastic | | |
| Temperature | 32° to 120° F (0° to 49° C) indoor operation only | | |
| Humidity Range | Up to 93% RH at 100° F (38° C) | | |
| Additional Information | Refer to Installation Instruction 574-877 | | |

This product has been approved by the California State Fire Marshal (CSFM) pursuant to Section 13144.1 of the California Health and Safety Code. See CSFM Listing 7300-0026:252 for allowable values and/or conditions concerning material presented in this document. It is subject to re-examination, revision, and possible cancellation. Additional listings may be applicable; contact your local Simplex product supplier for the latest status. Listings and approvals under Simplex Time Recorder Co. are the property of SimplexGrinell LP, Westminster.

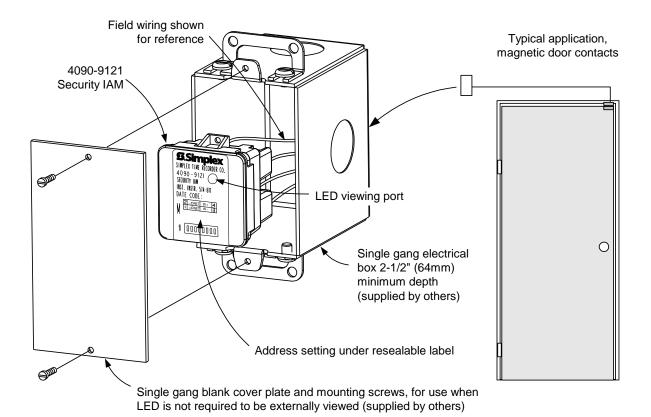

Mounting Reference, Single Gang Blank Cover Plate

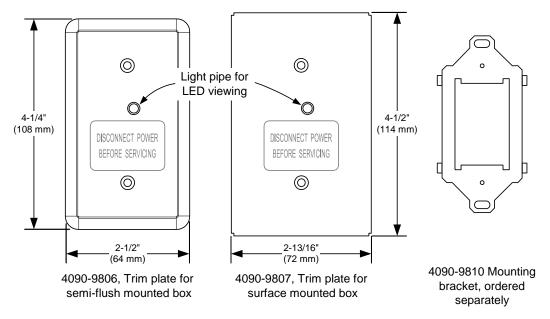

NOTE: These mounting plates require mounting bracket 4090-9810.

Optional Trim Plates and Mounting Bracket for Visible LED

Tyco is a registered trademark of Tyco International Services GmbH and is used under license. Simplex, the Simplex logo, and IDNet are trademarks of Tyco International Ltd. and its affiliates and are used under license.

